



www.kirkkey.com


Kirk Key Interlock Company

211 Wetmore Ave. S.E., Massillon, OH 44646

Phone: 330.833.8223 • Fax: 330.833.1528 • Toll Free: 800.438.2442

Email: sales@kirkkey.com

Type SKRU - Solenoid Key Release Unit Unhoused

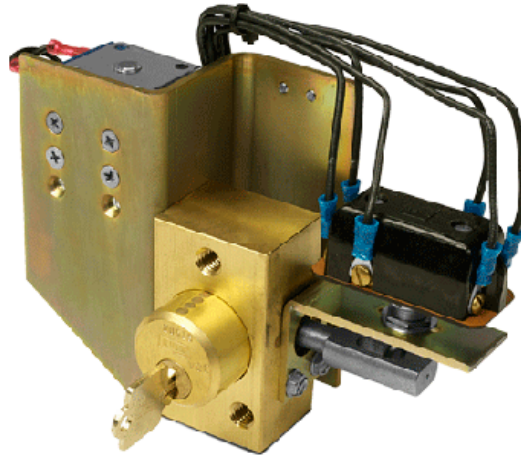

The Type SKRU consists of an interlock, a solenoid, and an auxiliary switch. The solenoid is designed to permit removal of the interlock key in response to an external electric signal. The auxiliary switch is a quick-make, quick-break device, which operates when the interlock key is rotated. Normally, the key is trapped in the SKRU and the solenoid is de-energized. To release the key, a signal must be sent to the solenoid from an external source.

The SKRU is typically used in combination with other KIRK® key interlocks. The SKRU can be manufactured with various mechanical and electrical options. The push button and/or the signal lamp are the most popular options. All components are UL recognized. The solenoid, optional signal lamp and optional push button are wired out to a terminal block along with some of the aux contacts. Please reference the wiring diagrams on our website for specific details.

The main body of the SKRU is constructed of brass. The optional cover plate and optional housing are aluminum.

OPTIONS

- Mounting Options – unhoused, cover plate only, or housed. The photo above shows the unhoused SKRU. The cover plate mounted version is shown on the next page. The housed version is shown on the SD Series Data Sheet 2.2a. The housed SKRU is available front or back panel mounted. See drawing on page 4 of Data Sheet 2.2A, as well as the interlock ordering guide.

- Key Removable – energized or de-energized. Please specify. Key removable energized is by far the most common.

- Signal Lamp – indicates that the external electric signal has been sent to the solenoid.

- Push Button – connected in series with the solenoid - the push button must be pressed to allow the external electric signal to energize the solenoid.



www.kirkkey.com

Kirk Key Interlock Company

211 Wetmore Ave. S.E., Massillon, OH 44646

Phone: 330.833.8223 • Fax: 330.833.1528 • Toll Free: 800.438.2442

Email: sales@kirkkey.com

Type SKRU - Solenoid Key Release Unit Cover Plate Mounted



OPTIONS (continued)

- Solenoid Voltage – 120VAC, 24VDC, 48VDC, or 125VDC.
- Auxiliary Switch – double pole/double throw (DP/DT) is standard. The DP/DT switch is UL recognized and rated 10A 250VAC or VDC, or 15A 125VAC or VDC. Four pole/double throw (4P/DT) is available.
- Gasket – available for weatherproofing with Housed option.
- Multi-Cylinder - up to 2 cylinders available. The two-cylinder SKRU can be keyed either of two ways, 1) both keys released together once the solenoid is energized or, 2) keyed so that one initiating key and the external signal to the solenoid are required to release a held key. See SD Series Data Sheet 2.2B (Unhoused) and/or SD Series Data Sheet 2.2C (Housed) for details.
- Stamp Key Interchange - specify an alphanumeric code to be stamped on the cylinder face and the key (e.g. A1, A2, B1, etc. - up to 5 characters). See SD Series Data Sheet for Keys (3.4) and Terminology (4.1) for details.
- Dust Covers - see SD Series Data Sheet for Dust Covers (3.1) for details.

Notes:

- 1) If both the signal lamp and push button are selected as options, the SKRU will be supplied with a combination signal lamp and push button as a single device.
- 2) If the Cover Plate Only mounting option is selected, the Unhoused SKRU will be mounted to an aluminum cover plate. Reference the drawing on page 4 of this Data Sheet.
- 3) Two-Cylinder SKRU information is shown on SD Series Data Sheets for 2-Key Unhoused (2.2B) and 2-Key Housed (2.2C).

SD SERIES - SPECIFICATION DATA SHEET 2.2



www.kirkkey.com


Kirk Key Interlock Company

211 Wetmore Ave. S.E., Massillon, OH 44646

Phone: 330.833.8223 • Fax: 330.833.1528 • Toll Free: 800.438.2442

Email: sales@kirkkey.com

Type SKRU - Solenoid Key Release Unit Unhoused, Front and Top View

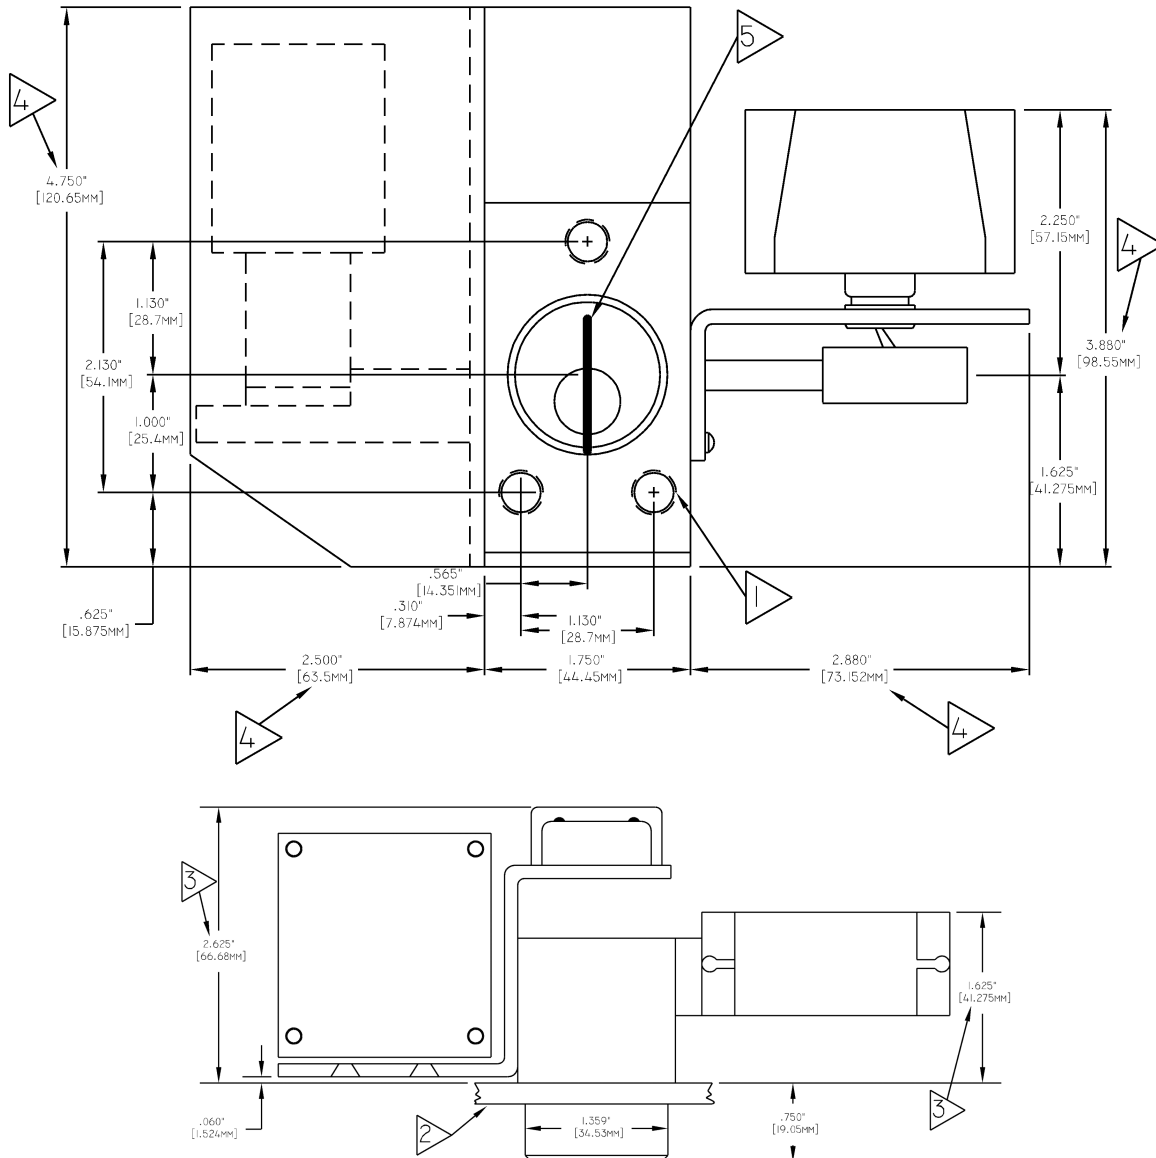

NOTES:

- 1) Three 3/8"-16 x 1" deep tapped holes for mounting (3 holes).
- 2) Mounting panel or coverplate.
- 3) Clearance dimension from back of panel.
- 4) Clearance dimension.
- 5) Operating key shown in held position.
- 6) See cover plate drawing on page 4 of this Data Sheet for lock cylinder and mounting hole dimensions for unhoused One-Key SKRU.

SD SERIES - SPECIFICATION DATA SHEET 2.2




www.kirkkey.com

Kirk Key Interlock Company

211 Wetmore Ave. S.E., Massillon, OH 44646
 Phone: 330.833.8223 • Fax: 330.833.1528 • Toll Free: 800.438.2442
 Email: sales@kirkkey.com

**Type SKRU - Solenoid Key Release Unit
 Cover Plate Dimensions**

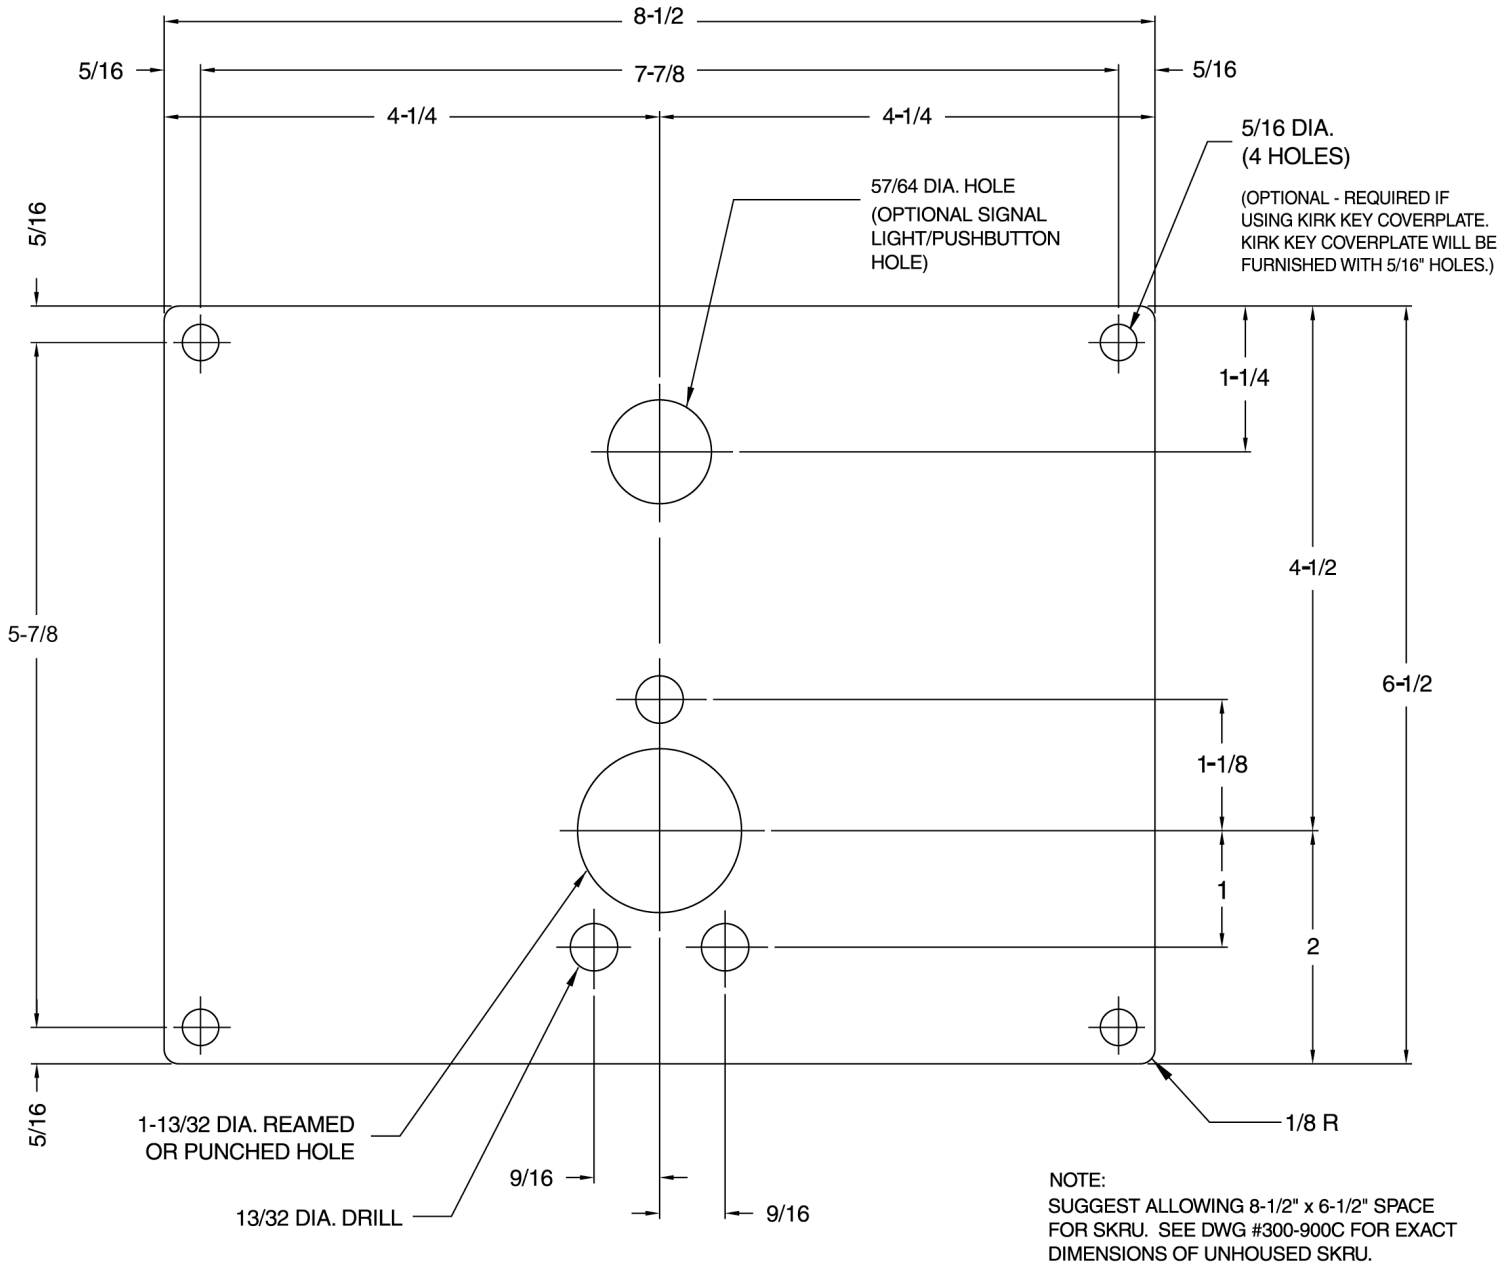

NOTE: This drawing provides the lock cylinder and mounting hole dimensions pertaining to unhooused SKRUs. It also provides overall dimensions and mounting hole locations for the cover plate if SKRU is purchased with cover plate only.